GENERAL NOTES:

- CONTRACTOR TO LIAISE WITH ALL RELEVANT UTILITY OPERATORS AFFECTED BY THE WORKS.
- ALL UTILITY LAYOUT PLANS AND TYPICAL CROSS-SECTIONS MUST BE READ IN CONJUNCTION WITH RELATED DRAWINGS (IN PARTICULAR, LIGHTING, STORMWATER, RETAINING WALLS, BRIDGES, BARRIER AND LANDSCAPING PLANS AND DETAILS) AND SPECIFICATIONS.DISCREPANCIES SHALL BE REFEREED TO THE ENGINEER FOR RESOLUTION.
- CONTRACTOR SHALL VALIDATE ALL AS-BUILT INFORMATION AND EXISTING UTILITIES ON SITE PRIOR TO 6 COMMENCEMENT OF CONSTRUCTION WORKS. DISCREPANCIES BETWEEN EXISTING UTILITIES AND AS-BUILT INFORMATION TO BE REFERRED TO THE ENGINEER FOR RESOLUTION
- THE CONTRACTOR IS RESPONSIBLE FOR SITE TEMPORARY SUPPLIES AND ENABLING WORKS
- WEEKEND WORKS MAY HAVE TO BE UNDERTAKEN TO ACCOMMODATE NETWORK OR CUSTOMER REQUIREMENTS; THE CONTRACTOR SHALL ACCOMMODATE THESE WEEKEND WORKS
- ALL CONNECTIONS TO PRIVATE PROPERTIES WILL BE ARRANGED AND COMPLETED BY RELEVANT UTILITY OPERATORS
- THE CONTRACTOR SHALL OBTAIN A PERMIT TO WORK AROUND SERVICES FROM RELEVANT UTILITY **OPERATORS**
- ALL REDUNDANT INFRASTRUCTURE IS TO BE ABANDONED UNLESS OTHERWISE AGREED WITH UTILITY
- **OPERATORS** CONTRACTOR TO IDENTIFY ANY CLASHES AT NEW SERVICE POLES, TERMINAL POLES, LIGHTING POLES. TRANSFORMERS, SWITCHES, PITS, PILLARS AND MANHOLE LOCATIONS PRIOR TO RELOCATING
- ALL DUCTS ARE TO BE CLEARED, CAPPED, TESTED AND DRAW WIRES INSTALLED, READY FOR UTILITY 3. OPERATORS TO DRAW CABLES
- ALL SERVICE LIDS TO BE FLUSH WITH FINISHED GROUND OR AS ACCEPTED BY THE ENGINEER. WHERE $\!\!\!\!\! ^{iggle}$ $\!\!\!\! ^4$. LIDS ARE LOCATED ON FOOTPATHS, SERVICES LID SHOULD HAVE ANTI-SKID SURFACING.
- ALL EXISTING SERVICE LINE TERMINATIONS OR RELOCATIONS SHALL BE AGREED WITH THE RELEVANT, 5. UTILITY OPERATOR ON-SITE
- CONTRACTOR TO REINSTATE ALL ABOVE GROUND SERVICES MARKERS

SERVICES BY SETTING OUT NEW LOCATIONS AND PILOT TRENCHING

- FINAL POSITION OF NEW SERVICE POLES, TERMINAL POLES, LIGHTING POLES, TRANSFORMERS SWITCHES, PITS, PILLARS AND MANHOLES TO BE AGREED ON SITE WITH CONTRACTOR'S ENGINEER AND RELEVANT UTILITY OPERATORS PRIOR TO CONSTRUCTION
- WHERE INDICATED ON LAYOUT PLANS, DUCTS SHALL BE LOCALLY DEEPENED OR MADE SHALLOW TO PASS STORMWATER PIPE/CULVERT CROSSINGS. A MINIMUM VERTICAL SEPARATION OF 150mm TO STORMWATER PIPES/CULVERTS AND MINIMUM/MAXIMUM BENDING RADIUS' FOR EACH SERVICE SHOULD BE MET
- THE LOCATION OF EXISTING SERVICES SHOWN ON PLANS IS INDICATIVE ONLY AS SOME EXISTING ASSETS MAY NOT HAVE BEEN CAPTURED. THE CONTRACTOR SHALL LIAISE WITH SERVICE PROVIDERS CONTRACTORS TO MARK OUT AND LOCATE EXISTING SERVICES PRIOR TO EXCAVATION. PILOT TRENCHING SHALL BE UNDERTAKEN TO DETERMINE THE ACTUAL POSITION OF EXISTING SERVICES. THE CONTRACTOR SHALL PROTECT THE EXISTING UTILITIES NETWORK AND IS RESPONSIBLE FOR ANY DAMAGES

VECTOR NOTES:

- CONTRACTOR TO ADHERE TO VECTOR'S 'GAS PIPELINE SAFETY GUIDE' AND 'A GUIDE TO WORKING SAFELY AROUND VECTOR'S ELECTRICITY, GAS AND COMMUNICATIONS NETWORKS' DOCUMENTS.
- WHEN WORKING WITHIN 2m OF A GAS PIPELINE, CONTRACTOR TO ACQUIRE A CLOSE APPROACH CONSENT. CONSENT TO BE ISSUED PRIOR TO STARTING WORK.
- JOB START DATE CONTRACTOR NAME CONTACT NUMBER PREFERRED APPOINTMENT DATE AND TIME TO BE INDICATED BY PHONE CALL AND EMAIL TO NETWORK PLANNER JOHN MCALISTER 021 996-989 OR JOHN.MCALISTER@ELECTRIX.CO.NZ. MINIMUM OF 48 HOURS NOTICE IS REQUIRED
- THE VECTOR POWER DUCTS INSTALLATION MUST COMPLY WITH THE FOLLOWING VECTOR STANDARDS:
 - VECTOR STANDARD ESE303 INSTALLATION REQUIREMENTS FOR CABLES AND DUCTS
 - VECTOR STANDARD EDE3021-3024 UNDERGROUND RETICULATION TRENCH PROFILE
 - VECTOR STANDARD ENS-0110 THERMAL BACKFILL FOR UNDERGROUND CABLES
 - VECTOR STANDARD CAP-095 CIVIL WORKS SPECIFICATION (NZS 3910)
 - VECTOR STANDARD END-2122 SERVICE PIT ARRANGEMENT TYPICAL CROSS-SECTION INSTALLATION DETAIL
- FOR EACH CROSSING BETWEEN VECTOR UTILITIES AND STORMWATER, THE CONTRACTOR MUST SUBMIT CONSTRUCTION METHODOLOGY TO VECTOR FOR APPROVAL
- CONTRACTOR TO ENSURE MINIMUM BENDING RADIUS OF CABLES / GAS PIPES ARE ADHERED TO.
- PILLARS TO BE 450L x 450W x 600H mm (ABOVE GROUND DUCTS) x 400D (BELOW GROUND).
- PITS TO BE 450mm DIAMETER AND 600mm DEEP U.N.O.
- FINAL MANHOLES, PITS, PILLARS, JOINTS, SERVICE POLES, TERMINAL POLES, TRANSFORMERS AND SWITCH LOCATIONS TO BE CONFIRMED ON SITE WITH VECTOR AND CONTRACTOR'S ENGINEER.

TRAFFIC SIGNAL NOTES:

- TRAFFIC SIGNAL EQUIPMENT AND INSTALLATION SHALL COMPLY WITH NZTA P43 SPECIFICATION FOR TRAFFIC SIGNAL (2018) AND THE AUCKLAND TRAFFIC MANAGEMENT UNIT: TRAFFIC SIGNALS DESIGN GUIDELINES (VERSION 3.0 AUGUST 2010).
- REFER TO SIGNAGE AND MARKING DRAWINGS 3235084-CT-2800 TO 2813 FOR DETAILS AND NOTES.

TRANSPOWER NOTES:

WHERE THE PROPOSED WORKS, INCLUDING USE OF MOBILE PLANT ARE WITHIN CLOSE PROXIMITY (CLOSER THAN 200m) TO TRANSPOWER TRANSMISSION LINES, THE CONTRACTOR SHALL INFORM TRANSPOWER PRIOR TO UNDERTAKING WORKS.

- 2. PITS TO BE 600L x 600W x 600D mm IN SIZE.
- FINAL MANHOLE AND PIT LOCATIONS TO BE CONFIRMED ON SITE WITH CHORUS.
- CHORUS SHALL CONNECT NEW DUCTS/CABLES TO EXISTING CHORUS DUCTS AND CABLES
- NEW CHORUS FIBRE CONNECTIONS TO PROPERTIES MAY HAVE BEEN INSTALLED THAT HAVE NOT BEEN IDENTIFIED IN THESE DRAWINGS. PRIOR TO CONSTRUCTION ALL NEW CONNECTIONS MUST BE IDENTIFIED BY CONTACTING DANIEL SAMUEL PH. 0212970982
- THE RIBBONET DUCT TO BE LAID CLOSEST TO THE BOUNDARY TO INSTALL DROP OFF'S. CONTRACTOR TO LIAISE WITH VISIONSTREAM FIELD MANAGER FOR ALL ASPECTS OF RIBBONET INSTALLATION.
- THE STANDARD GROUND COVER REQUIRED IS 600mm FOR NEW DUCT LINES IN STABLE WELL FORMED AREAS AND 1.0m UNDER CARRIAGEWAY AREAS UNLESS SPECIFIED OTHERWISE

SPARK NOTES:

- THE SPARK HIGH VOLTAGE INTERNATIONAL CABLE RUNS ALONG THE NORTHERN SIDE OF SH16 INSIDE A SHARED TRENCH WITH CHORUS COMMUNICATION DUCTS. THE LOCATION AND DEPTH OF INTERNATIONAL CABLE SHALL BE CONFIRMED PRIOR TO COMMENCEMENT OF ANY WORKS, AND THE INTERNATIONAL CABLE SHALL BE PROTECTED AT ALL TIMES DURING CONSTRUCTION.
- SPARK INTERNATIONAL PATROLMAN IAN MACCLURE (OR NOMINATED ALTERNATIVE) WILL BE REQUIRED TO STAND OVER DURING THE INSTALLATION OR RELOCATION OF ANY WORKS WITHIN THE VICINITY OF THE SPARK INTERNATIONAL CABLE.
- THE CONTRACTOR SHALL NOTIFY AND LIAISE WITH SPARK FOR THE REVIEW OF PROPOSED RELOCATION/PROTECTION METHODOLOGY.
- THE EXISTING SPARK DUCTS AND CABLES, INCLUDING THE SOUTHERN CROSS INTERNATIONAL CABLE, ARE NOT REQUIRED TO BE RELOCATED
- THE EXISTING SPARK DUCTS AND CABLES, INCLUDING THE SOUTHERN CROSS INTERNATIONAL CABLE, ARE TO BE PROTECTED AT ALL TIMES
- THE CONTRACTOR(S) DOING THE WORKS SHALL NOT EXCAVATE WITHIN 0.5m VERTICAL CLEARANCE OR 1m LATERAL CLEARANCE OF THE SPARK DUCTS AND CABLES, INCLUDING THE SOUTHERN CROSS
- SPARK SHALL BE CONSULTED ON ANY DESIGN CHANGES THROUGHOUT THE PROJECT THAT MAY AFFECT THE ONGOING OPERATION OF SPARK DUCTS AND CABLES, INCLUDING THE SOUTHERN CROSS INTERNATIONAL CABLE
- THE PROJECT DESIGN WILL AIM TO PROVIDE FOR ONGOING ACCESS TO THE SPARK DUCTS AND CABLES, INCLUDING THE SOUTHERN CROSS INTERNATIONAL CABLE, ESPECIALLY SPARK MANHOLES. FOR ONGOING OPERATIONAL PURPOSES AND FOR THE REUSE OF THE DUCTLINE FOR FUTURE DABLES WHERE THIS MAY NOT BE ACHIEVED, PROJECT DESIGN TEAM SHALL NOTIFY SPARK AND LIAISE WITH SPARK TO ARRIVE AT AN ACCEPTABLE ALTERNATIVE DESIGN SOLUTION

VODAFONE NOTES:

- PITS TO BE 1200L x 600W x 900D mm IN SIZE
- FINAL MANHOLE AND PIT LOCATIONS TO BE CONFIRMED ON SITE WITH VODAFONE
- VODAFONE SHALL CONNECT NEW DUCTS/CABLES TO EXISTING VODAFONE DUCTS AND CABLES THE STANDARD GROUND COVER REQUIRED IS 900mm FOR NEW DUCT LINES IN STABLE WELL FORMED
- AREAS AND 1.0m UNDER CARRIAGEWAY AREAS UNLESS SPECIFIED OTHERWISE
- THE LOCATION OF EXISTING SERVICES SHOWN ON PLANS IS INDICATIVE ONLY AS SOME EXISTING ASSETS MAY NOT HAVE BEEN CAPTURED. THE CONTRACTOR SHALL LIAISE WITH VODAFONE CONTRACTORS TO MARK OUT AND LOCATE EXISTING SERVICES PRIOR TO EXCAVATION. PILOT TRENCHING SHALL BE UNDERTAKEN TO DETERMINE THE ACTUAL POSITION OF EXISTING SERVICES. THE CONTRACTOR SHALL PROTECT THE VODAFONE NETWORK AND IS RESPONSIBLE FOR ANY DAMAGES.

VOCUS NOTES:

- JOINTING PITS TO BE SIKA ALUMINIUM MANHOLE 1200L x 600W x 1200D mm IN SIZE.
- FINAL MANHOLE AND PIT LOCATIONS TO BE CONFIRMED ON SITE WITH VOCUS.
- VOCUS SHALL CONNECT NEW DUCTS/CABLES TO EXISTING VOCUS DUCTS AND CABLES.
- THE STANDARD GROUND COVER REQUIRED IS 600mm FOR NEW DUCT LINES IN STABLE WELL FORMED AREAS AND 1.0m UNDER CARRIAGEWAY AREAS UNLESS SPECIFIED OTHERWISE.


WATERCARE NOTES:

- EXISTING CRITICAL WATERMAIN (450 OD PE100) IS TO BE RETAINED AND PROTECTED DURING
- PIPELINE SHALL BE INSTALLED WITH THE FOLLOWING DEPTH TO INVERT MEASURED TO THE FINAL SURFACE LEVEL
- IN BERMS A MINIMUM COVER OF 600mm UP TO A MAXIMUM OF 1000mm:
- IN CARRIAGEWAYS A MINIMUM 900mm UP TO 1200mm: OF
- AS OTHERWISE AGREED OR REQUIRED BY WATERCARE AND THE CORRIDOR MANAGER WHERE THE WORKS ARE IN THE ROAD RESERVE


CONSTRUCTION CO-ORDINATION CHECKS:

CHORUS, VECTOR AND NZTA CONTRACTORS TO SET OUT PERMANENT WORKS FOR PRIVATE PROPERTY CONNECTIONS (PITS, PILLARS, SERVICE POLES) WITH THE CONTRACTOR PRIOR TO THE COMMENCEMENT OF CONSTRUCTION TO ALLOW FOR A FINAL COORDINATION CHECK TO BE MADE BY ALL RELEVANT PARTIES.

STORMWATER LEGEND

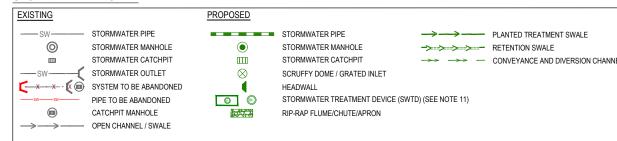

EXISTING SERVICES LEGEND:

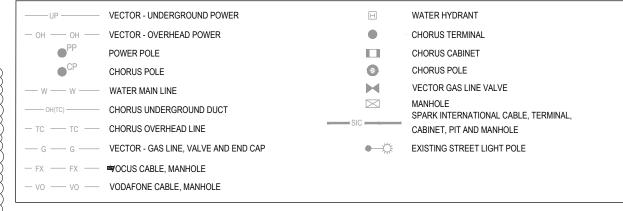


PROPOSED SERVICES LEGEND:



BARRIERS/RETAINING WALL



LIGHTING LEGEND:



NEW STREET LIGHT DUCT/CABLE, PIT AND MONTROSE BOX NEW STREET LIGHT POLE / NEW LUMINAIRE EXISTING STREET LIGHT POLE TO REMAIN EXISTING STREET LIGHT POLE TO BE REMOVED NEW MONTROSE BOX

GENERAL LEGEND:

	PROPERTY BOUNDARY	196700	CHAINAGE
	ROAD / RAIL DESIGNATION	016-0019-B/6.5	ROUTE POSITION (RP)
		499	PROPERTY NUMBER



CHORUS NOTES:

MANHOLES TO BE STANDARD SIKA 1200L x 600W x 600Dmm

- 1	Ι.						
	lſ	D	FOR CONSENT	VZ	VZ	GC	14.11.22
	П	С	FOR CONSENT	VZ	VZ	GC	12.10.22
	П	В	DRAFT DETAILED DESIGN	ОН	VZ	GC	19.01.2
		Α	PRELIMINARY DESIGN	TW	VZ	NL	26.03.2
1	П	M.	Destrict	D.,	Ohli	Annd	Dete



	Original Scale (A1) NTS Reduced Scale (A3) NTS	Design	T.WU	26.03.21	Approved For
		Drawn	ES, OH	26.03.21	Construction*
		Dsg Verifier	KM	10.10.22	
		Dwg Check	KM	10.10.22	Date
		* Refer to Revision 1 for Original Signature			



SH16 - SAFETY IMPROVEMENTS STAGE 2 **BRIGHAM CREEK TO KUMEU**

COMBINED SERVICES PLAN NOTES AND LEGEND

CIVIL ENGINEERING 3235084-CU-2050

